


# UNION CITY ENERGY AUTHORITY

## TYPICAL 200 AMP. OVERHEAD SERVICE SPECIFICATIONS

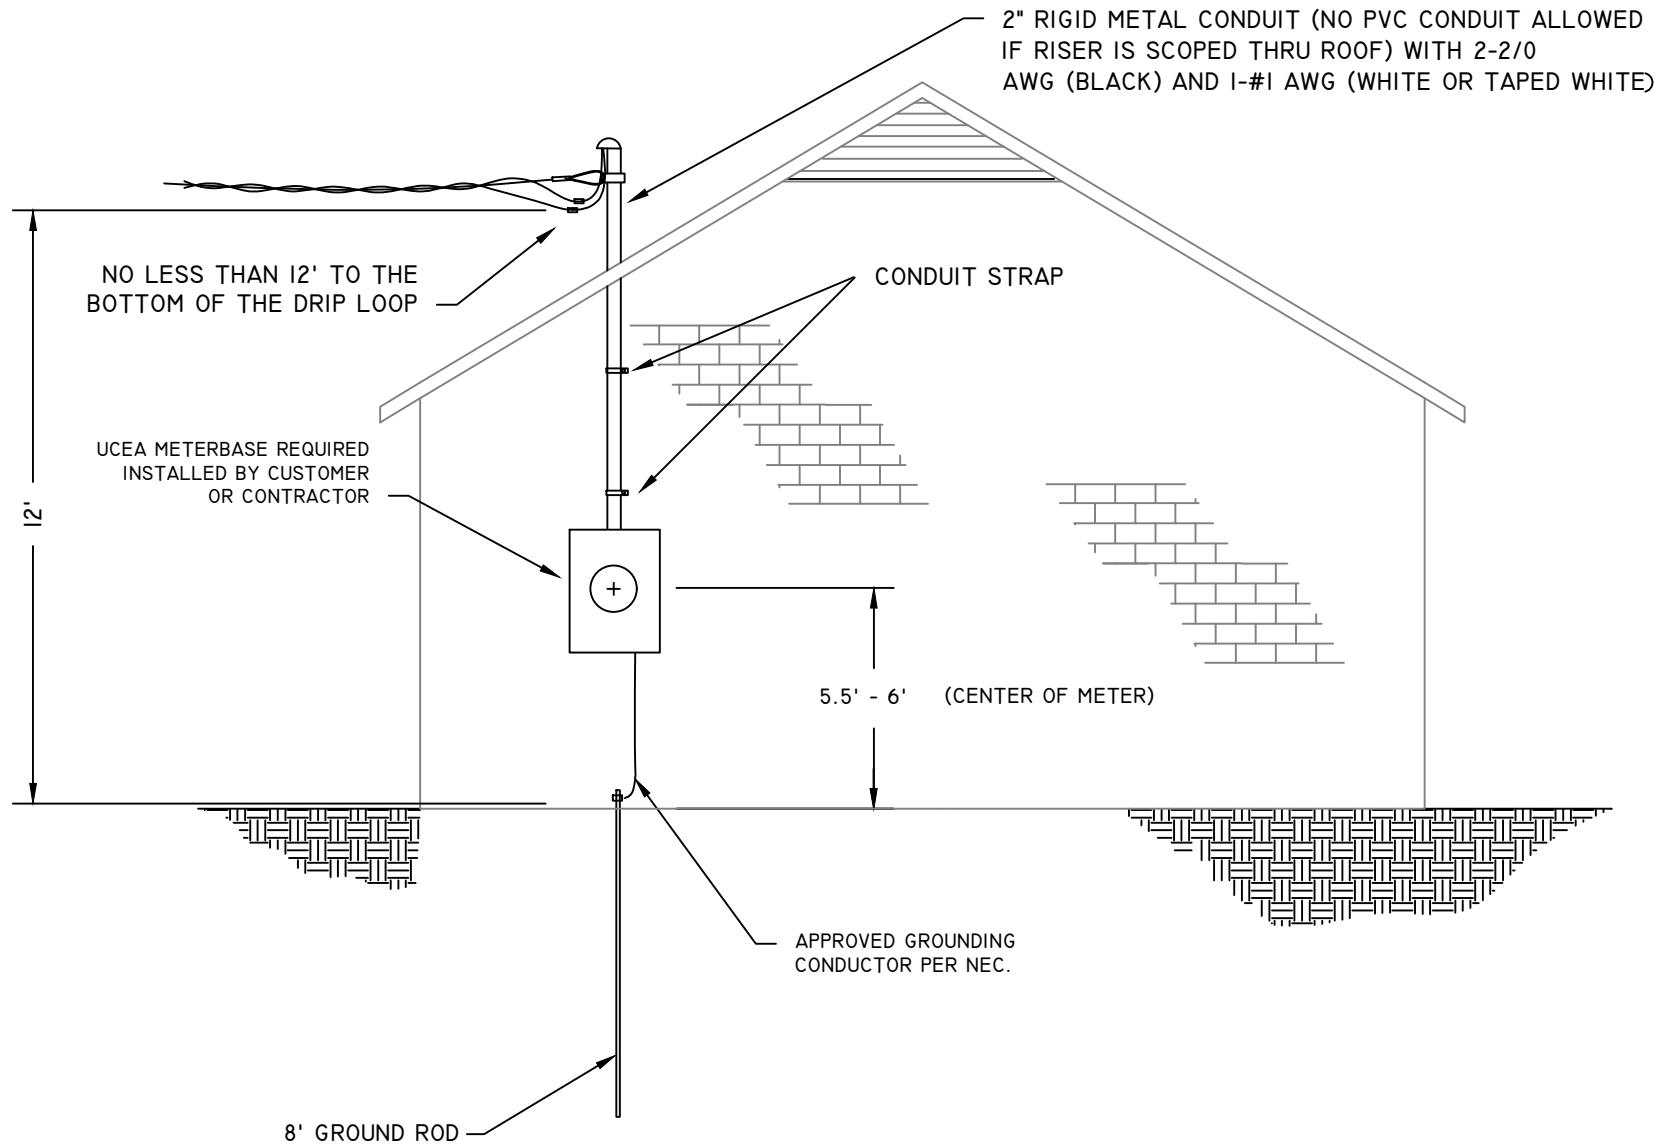

NOTE: ALL WIRING MUST COMPLY WITH ALL LOCAL, STATE, AND NATIONAL ELECTRICAL CODES  
-PANEL INSIDE HOUSE SHALL BE WITHIN 2FT OF BACK OF METERBASE  
-METER LOCATION MUST BE APPROVED BY AN EMPLOYEE OF UCEA