


# UNION CITY ENERGY AUTHORITY

## TYPICAL TEMPORARY SERVICE SPECIFICATIONS

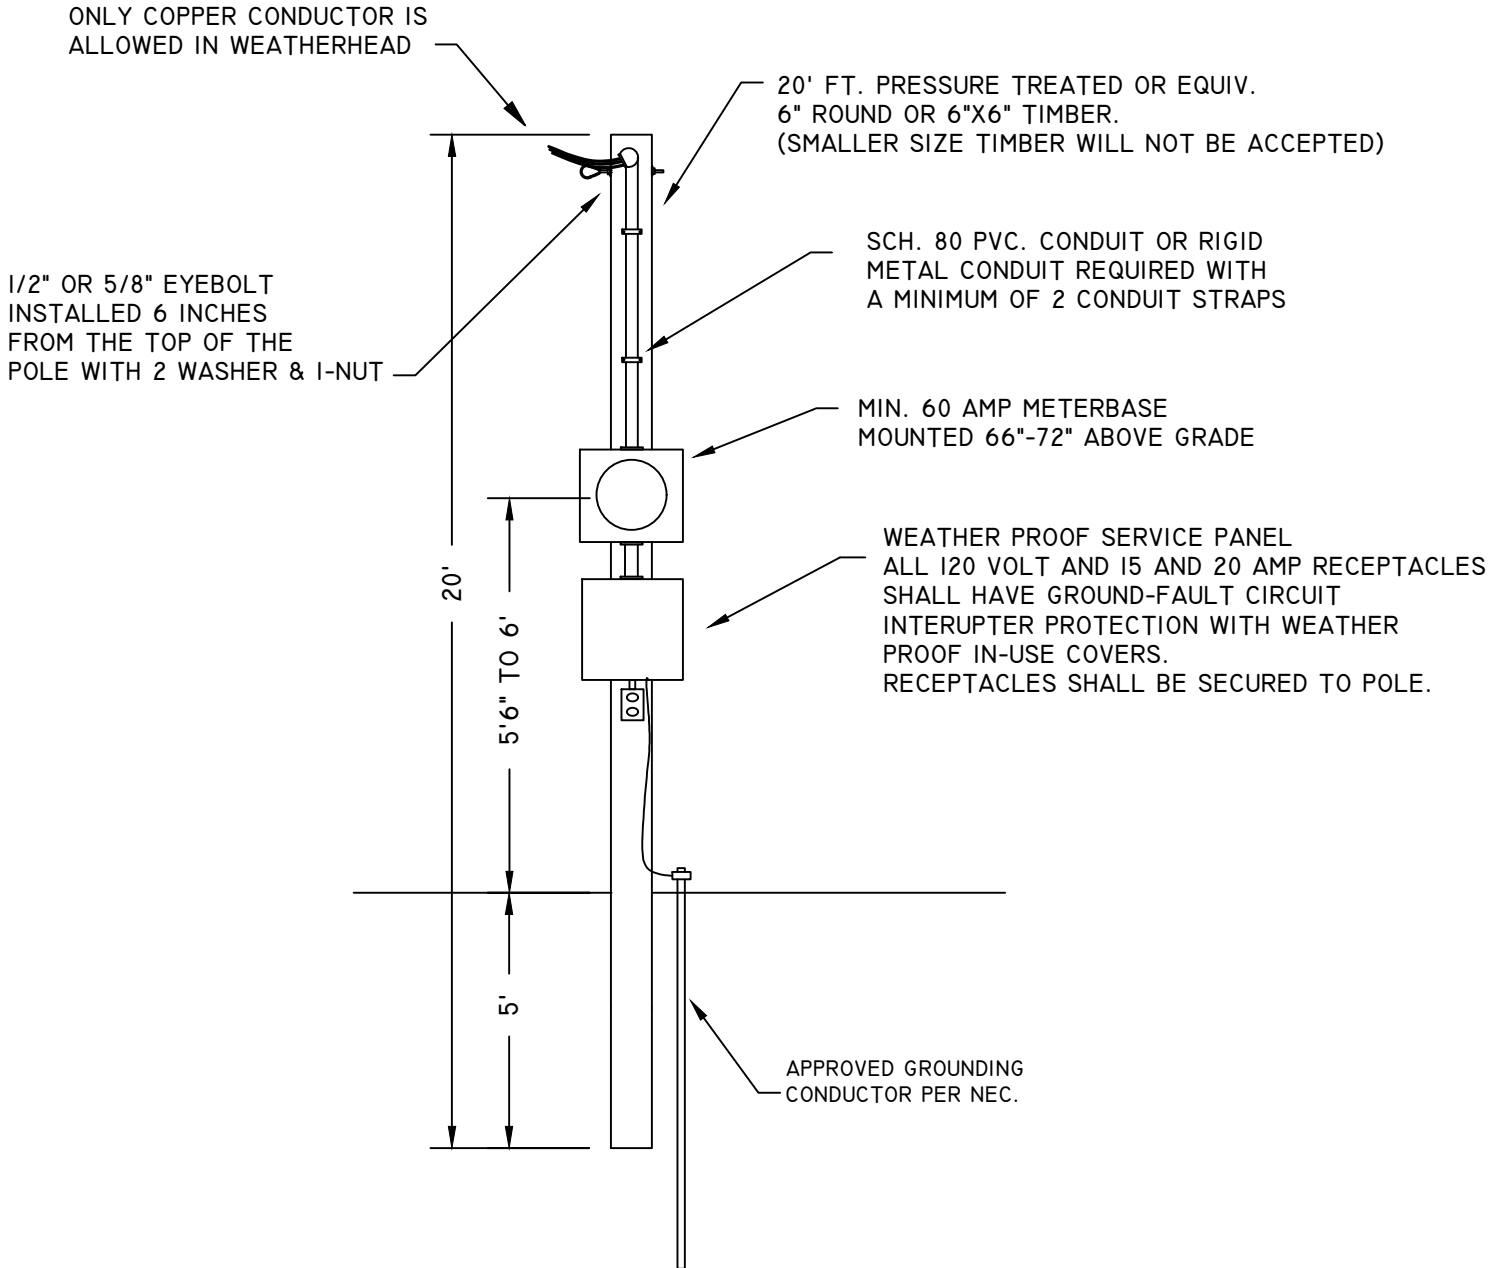

NOTES:

1. TEMPORARY SERVICE POLE LOCATION MUST BE APPROVED BY AN EMPLOYEE OF UCEA
2. SPECIAL CONDITIONS MAY REQUIRE ADDITIONAL SERVICE WIRE CLEARANCES. EXAMPLE: PARKING LOTS ETC.

DATE: REVISED 08/09/19