


UNION CITY ENERGY AUTHORITY TYPICAL 200 AMP UNDERGROUND METERBASE SPECIFICATIONS

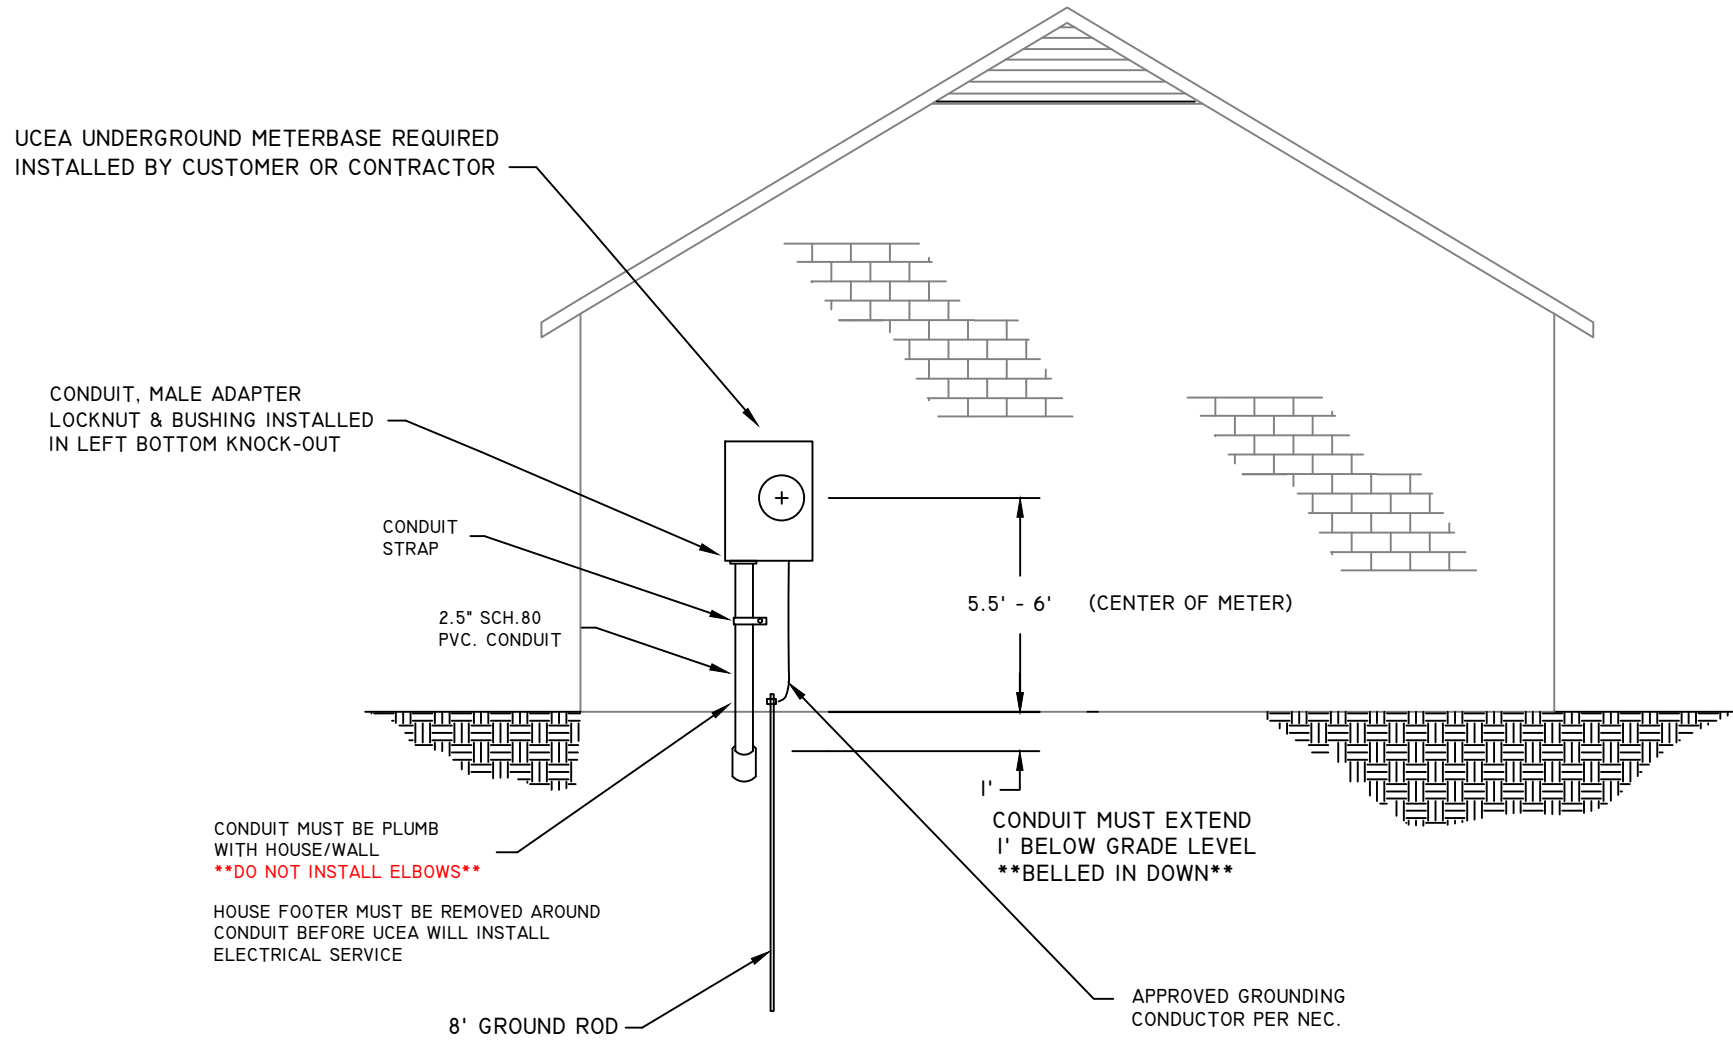

NOTE: ALL WIRING MUST COMPLY WITH ALL LOCAL, STATE, AND NATIONAL ELECTRICAL CODES
 -PANEL INSIDE HOUSE SHALL BE WITHIN 2 FT OF BACK OF METERBASE
 -METER LOCATION MUST BE APPROVED BY A EMPLOYEE OF UCEA